

1 Introduced March 23, 2010, by Councilman
2 Hicks, seconded by Councilman Cusimano, (by
3 request of Administration)

4 **Item No. 10-03-2848**

5 **ORDINANCE NO. 3569**

6 An ordinance amending the Code of Ordinances of the City of Slidell,
7 Appendix B, Subdivision Regulations, Section 4.701(2) and (3) relative to fire hydrants.
8

9 WHEREAS, St. Tammany Fire Protection District No. 1 has requested
10 amendments to the Subdivision Regulations relative to fire hydrants.
11

12 NOW THEREFORE BE IT ORDAINED by the Slidell City Council that it does
13 hereby amend the Code of Ordinances of the City of Slidell, Appendix B, Subdivision
14 Regulations, as follows:
15

16 Section 4.701(2) be rescinded and re-enacted to read as follows:
17

18 "Water mains shall be of sufficient size to provide at least one standard fire
19 hydrant unit within 400 feet of each one or two family dwelling structure. Water mains shall
20 be of sufficient size to provide at least one standard fire hydrant unit within 300 feet to
21 each part of a commercial or industrial structure with an area exceeding 12,000 square
22 feet. Water mains shall be of sufficient size to provide at least one standard fire hydrant
23 unit within 300 feet to any part of a commercial or industrial structure with an area less
24 than 12,000 square feet. Water mains shall comply with all rules and regulations of the
25 State rating bureau. The distance measurements required by this subsection shall be
26 determined by "hose lay" path."
27

28 BE IT FURTHER ORDAINED that Appendix B, Subdivision Regulations,
29 Section 4.701(3) be rescinded and re-enacted to read as follows:
30
31
32
33
34
35
36
37
38
39

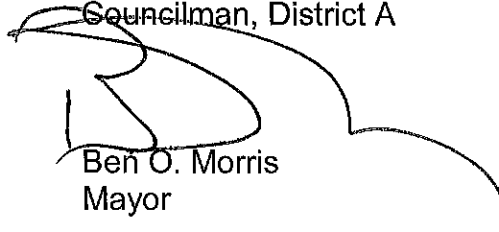
1 **ORDINANCE NO. 3569**
2 **ITEM NO. 10-03-2848**
3 **PAGE 2**

4 "If an additional hydrant or hydrants are required to comply with the provisions
5 of subsection (2), the hydrants shall be fed by a service line that is looped back into a main
6 water line so that creation of a dead end line is avoided. Location and connection of the
7 hydrant of the hydrant units shall be subject to the approval of the fire protection bureau,
8 the Slidell building official and the Slidell City Engineer."
9
10
11

12 **ADOPTED** this 27th day of April, 2010.

13
14 

15 Lionel Hicks
16 President of the Council
17 Councilman, District A

18
19 
20
21 Ben O. Morris
22 Mayor

23 

24 Thomas P. Reeves
25 Council Administrator

DELIVERED	12:30 p.m.
4/30/10	to the Mayor
RECEIVED	2:45 p.m.
5/4/10	from the Mayor