

ORDINANCE NO. 948

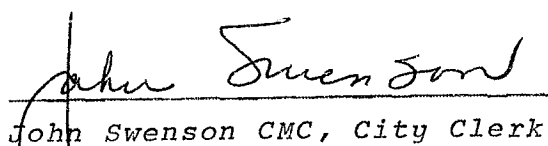
Be it ordained by the Mayor and City Council of the City of Slidell, Louisiana, that Ordinance No. 679, dated April 2nd, 1963, as amended by Ordinance No. 681, dated June 4th, 1963, Ordinance No. 737, dated October 5th, 1965, be further amended to read:

Slidell Plumbing Code:

- 1 - Meter connection on water service lines:
 - a. Copper 2-6" galvanized nipples and union (for future meter).
 - b. Galvanized 1-10" piece of pipe from curb cock to union. Nipple and coupling to service.
- 2 - Sewer connection to mains:
 - a. Height of cleanouts at property line 8" from top of ground.
 - b. 6x4 double Y - First man to tie into double Y extend 6" cleanout to within 8" of ground and continue on from 4" Y outlet.
 - c. 6" Y - Install 6" Y & Cleanout, 6x4 reducer and continue on with sewer line.
 - d. 6" double Y - 6" to property cleanout within 8" of ground, 6x4 reducer and continue on with sewer line.
- 3 - Sewer tapping fees:
 - a. Old sewer mains: Tapping fee of \$50.00.
 - b. Subdivision - Sewer taps are paid by developer on original installation.
- 4 - Sewer lines:
 - a. The shortest distance between building drain and main sewer line must be followed.
- 5 - Drum Traps:
 - a. Drum traps used as specified refer to page 17 p 5 22.
- 6 - Helper must be under direct supervision of journeyman plumber at all times while work is in progress.
- 7 - Condensate (P) Traps:
 - a. 2" (P) Traps must be installed on all condensate drains.
- 8 - Water Supply Lines:
 - a. Under slab - Type L soft copper only.
 - b. Above slab - Type "L" copper only.
 - c. Outside service - Type "L" copper or galvanized or plastic - AFT M PUC D1785 Sec. 40.

Duly introduced and adopted this 27th day of August, 1974.


Frank N. Cusimano, Mayor


John Swenson CMC, City Clerk